

HARWINTON FIRE MARSHAL

Please see the attached information sheets for the use of Propane Tanks, Fire Extinguishers and Extension Cords in your Concession Food Stand/Food Truck.

All concessions will be inspected prior to the start of the event and as needed during the event by the Fire Marshal's Office.

There shall be no open flame style heaters/fire places (i.e. patio/umbrella style, torpedo) used in tents, or buildings.

Use of wood burning style ovens/stoves will be evaluated by the Fire Marshal's Office to ensure proper distance from other concessions.

Generators shall be grounded in accordance with the manufacturer data sheets/instructions.

Generator fuel cans shall be stored in the upright position and kept in a secure location allowing for proper venting.

Should you have any questions on any of the requirements please email my office at firemarshal@harwinton.us

PROPANE TANKS

All tanks SHALL BE individually secured to prevent tipping

All tanks SHALL BE stored outside to allow for proper venting

All tanks SHALL BE stored and used in the upright position

All tanks SHALL BE in good condition free of excess damage/corrosion


ALL TANKS SHALL BE WITHIN THE CORRECT DATE RANGE

Is your propane cylinder **SAFE?**

Propane cylinders must be periodically requalified to be safe for use*. Do not use cylinders that have not been requalified because you risk property damage, severe injuries, or death.

To see if your cylinder is okay to use, look for these markings:

- A** **Manufacturing Date:**
Cylinders must be requalified within 12 years of manufacture (in this illustration by May 2017).
- B** **Requalification Date:**
If the cylinder is older than 12 years, look for a "requalification date".

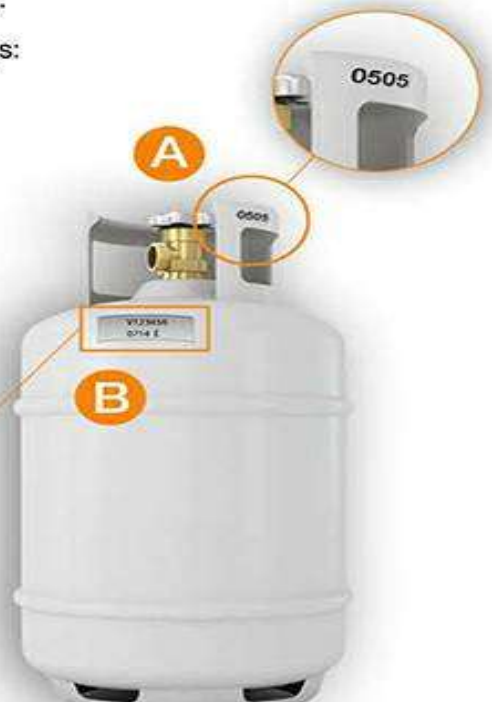

TANKS OUT OF DATE OR IN POOR CONDITION WILL BE DISCONNECTED AND REMOVED FROM THE GROUNDS

FIRE EXTINGUISHERS

ALL FIRE EXTINGUISHERS SHALL BE INSPECTED AND TAGGED.

ALL FIRE EXTINGUISHERS SHALL BE ASSESSABLE

**All concessions that use cooking equipment producing grease laden vapors
SHALL HAVE A K RATED FIRE EXTINGUISHER.**

(i.e. Flat Top Grills, Deep Fat Fryolators, WOK Type grills, Kettle Corn Pans)

**Food trucks with a built-in kitchen hood fire suppression system that is in use
SHALL HAVE current inspection certificates and annual tag.**

**All concessions that use other cooking equipment or heating equipment
SHALL HAVE A 10 LB ABC RATED FIRE EXTINGUISHER**

(i.e. Convection Ovens, Pizza Trucks, Wood Fire Ovens, Hot Plates)



Concessions without the proper style extinguishers
and **INSPECTED AND IN-DATE TAGS**

Will not be allowed to use that equipment associated with the equipment requirement

(i.e. Class K for Deep Fat Style Fryolators)


EXTENSION CORDS

All cords shall be 10, 12- or 14-gauge w/ground

All cords shall be rated properly for the equipment that they are powering

All cords shall be in good working condition

Cord Gauge vs Amperage

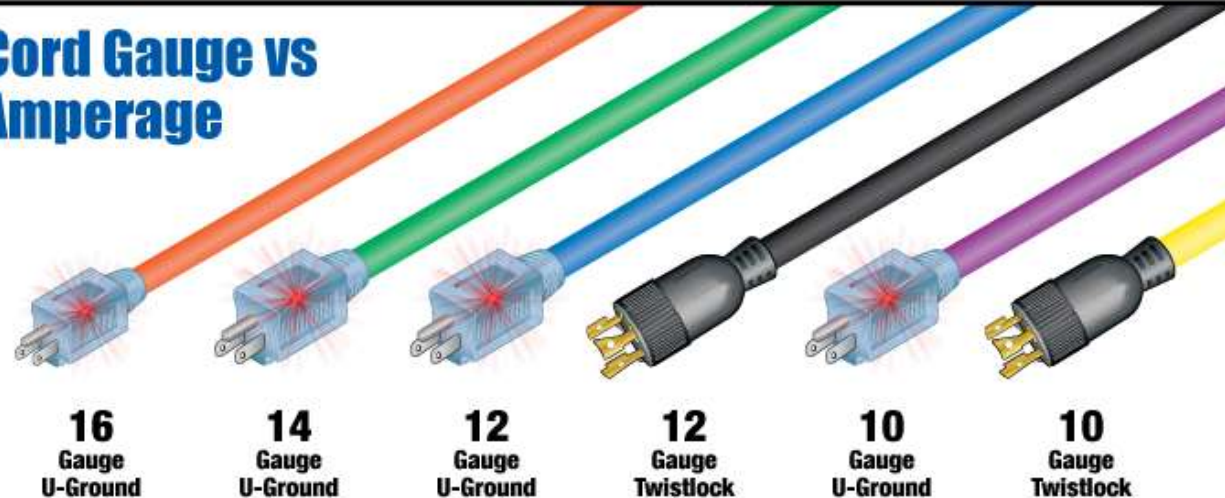

16 Gauge U-Ground **14 Gauge U-Ground** **12 Gauge U-Ground** **12 Gauge Twistlock** **10 Gauge U-Ground** **10 Gauge Twistlock**

Usage Guide

MEDIUM DUTY	HEAVY DUTY	EXTRA HEAVY DUTY	EXTRA HEAVY DUTY	ULTRA HEAVY DUTY	ULTRA HEAVY DUTY
Fans	Drills	Impact Hammers	Circular Saws	Generators	Generators
Small Appliances	Belt Sanders	Chain Saws	Chain Saws	Recipro Saws	Chop Saws
Stereos	Routers	Recipro Saws	Table Saws	Rotary Hammers	Rotary Hammers
Household Tools	Hedge Trimmers	Grinders	Worm Drives	Compressors	Tile Saws

Amperage Chart

	16 GAUGE	14 GAUGE	12 GAUGE U-GROUND	12 GAUGE TWISTLOCK	10 GAUGE U-GROUND	10 GAUGE TWISTLOCK
25ft.	13 Amps	15 Amps	15 Amps	20 Amps	15 Amps	20 Amps
50ft.	13 Amps	15 Amps	15 Amps	20 Amps	15 Amps	20 Amps
100ft.	10 Amps	13 Amps	15 Amps	15 Amps	15 Amps	20 Amps